THIS REVISED SHEET C6.2
IS ATTACHMENT #30 TO
ADDENDUM #1

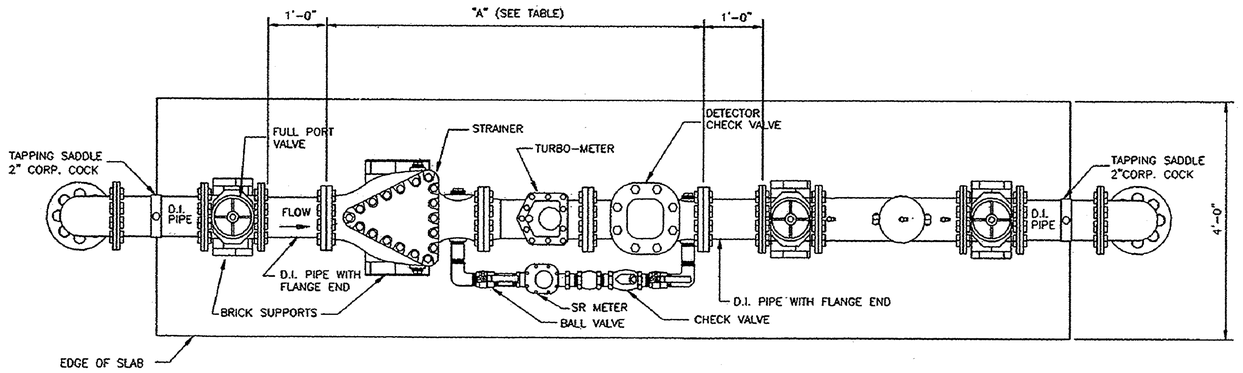

PLAN VIEW
SCALE: 3/4" = 1'-0"

TURBO METER	"A" DIMENSION IN INCHES
4"	52"
6"	68"
8"	77"
10"	99"

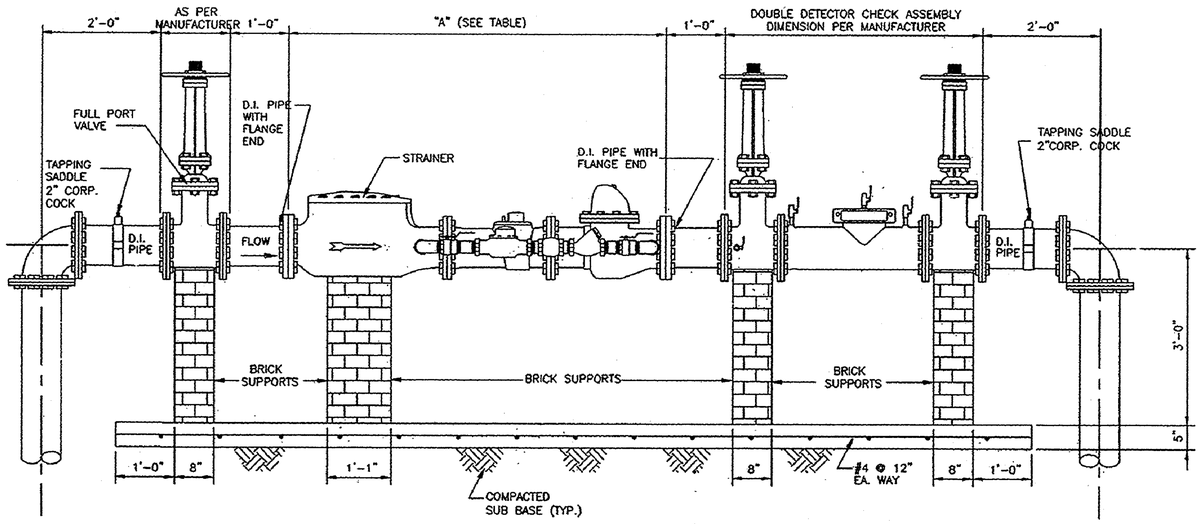

LONGITUDINAL SECTION
SCALE: 3/4" = 1'-0"

NOTES:

1. THE METER LOCATION SHALL NOT EXCEED 15' INSIDE THE PROPERTY LINE.
2. BACKFLOW PREVENTERS MUST BE LISTED AND CERTIFIED IN ACCORDANCE WITH THE UNIVERSITY OF SOUTHERN CALIFORNIA (USC) FOUNDATION FOR CROSS-CONNECTION CONTROL AND HYDRAULIC RESEARCH.

1 / C6.2 DOUBLE DETECTOR CHECK BACKFLOW PREVENTOR N.T.S.

NOTES:

1. CONTRACTOR SHALL PROVIDE ABS ENCLOSURE THAT WILL COVER COMPLETE ASSEMBLY. ENCLOSURE SHALL HAVE ACCESS PANELS PLACED SO THAT INDIVIDUAL COMPONENTS CAN BE ACCESSED FOR MAINTENANCE.
2. INSULATE ALL PIPES AND FITTINGS AS REQUIRED BY LOCAL GOVERNING UTILITY COMPANY AND LOCAL PREVAILING WEATHER CONDITIONS
3. CONTACT LOCAL GOVERNING UTILITY COMPANY FOR WATER METER ON RESERVE FOR USE AT THIS SITE.

REVISIONS	BY
06/22/10	SCP

CONTRACTOR MUST VERIFY AND CHECK ALL JOB DIMENSIONS, DETAILS AND SPECIFICATIONS ON SITE AND REPORT ANY ERRORS, OMISSIONS AND DISCREPANCIES BEFORE PROCEEDING

NEW-PHOENIX-PRE-K-THROUGH-12-SCHOOL
NEW-PHOENIX-PRE-K-THROUGH-12-SCHOOL
12700-HWY.-39-BRAITHWAITE,-LOUISIANA-70040
FEMA-PW-4987

ATTACHMENT
NUMBER 30
TO ADDENDUM
NUMBER ONE

SEAL
STATE OF LOUISIANA
DONALD C. MAKOFSKY
REG. NO. 19436
REGISTERED
PROFESSIONAL ENGINEER
IN
CIVIL ENGINEERING
04-23-10

DRAWN:	SCP
CHECKED:	SCP
SCALE:	AS NOTED
DATE:	05/21/2010

C6.2

© 2009

MORPHY MAKOFSKY INCORPORATED
CONSULTING ENGINEERS
(504)488-1317
JOB NO. 09157