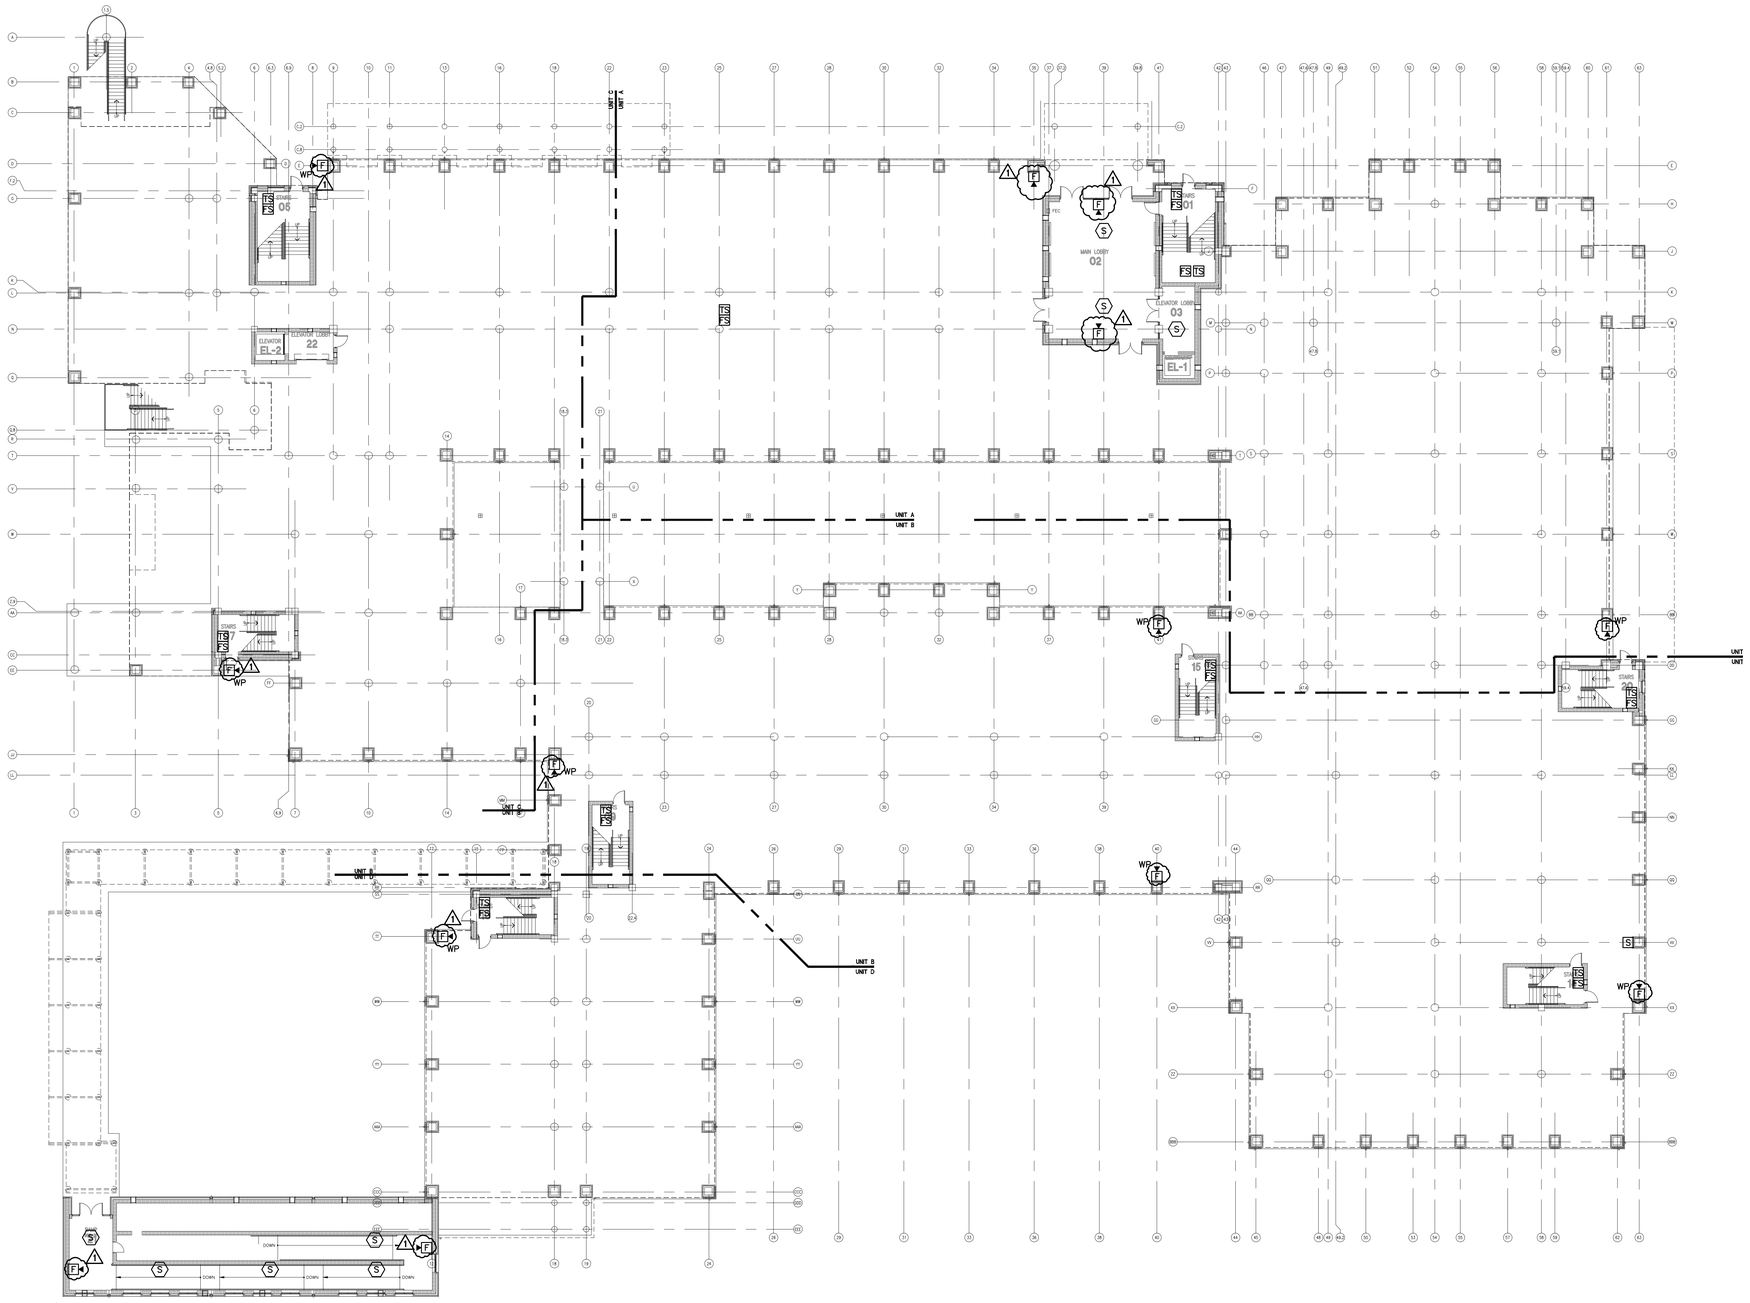

GENERAL NOTES:

1.) ADDITIONAL FIRE ALARM DEVICES MAY BE REQUIRED BY APPLICABLE BUILDING CODES AND/OR THE STATE FIRE MARSHALL. IT IS THE CONTRACTOR'S RESPONSIBILITY TO INSURE THAT ALL FIRE ALARM DEVICES ARE INCLUDED IN THE BID AND TO CONFIRM THAT THE BUILDING'S FIRE ALARM SYSTEM MEETS ALL APPLICABLE CODES AND REQUIREMENTS OF THE STATE FIRE MARSHALL. THE CONTRACTOR SHALL PROVIDE ALL FIRE ALARM CONTRACT DOCUMENTS OR NOT.

1 GROUND FLOOR FIRE ALARM PLAN
SCALE: 1/16" = 1'-0"

PROJECT NORTH TRUE NORTH

ATTACHMENT NUMBER 49 TO ADDENDUM NUMBER ONE

REVISIONS	BY
1 06-22-10	ADG

CONTRACTOR MUST VERIFY AND CHECK ALL JOB DIMENSIONS, DETAILS AND SPECIFICATIONS ON SITE AND REPORT ANY ERRORS, OMISSIONS AND DISCREPANCIES BEFORE PROCEEDING

NEW PHOENIX PRE-K THROUGH 12 SCHOOL

GROUND FLOOR FIRE ALARM PLAN

SEAL

ASSOCIATED DESIGN GROUP, INC.
CONSULTING ENGINEERS

CORPORATE OFFICE
114 Toledo Drive
Lafayette, Louisiana 70506
(337) 234-5710

NEW ORLEANS BRANCH
1010 Common St.
Suite 2405
New Orleans, LA 70112
(504) 581-6333

Project # 09193

DRAWN:	JAM
CHECKED:	RAG
SCALE:	
DATE:	05-24-2010

E2.16

©