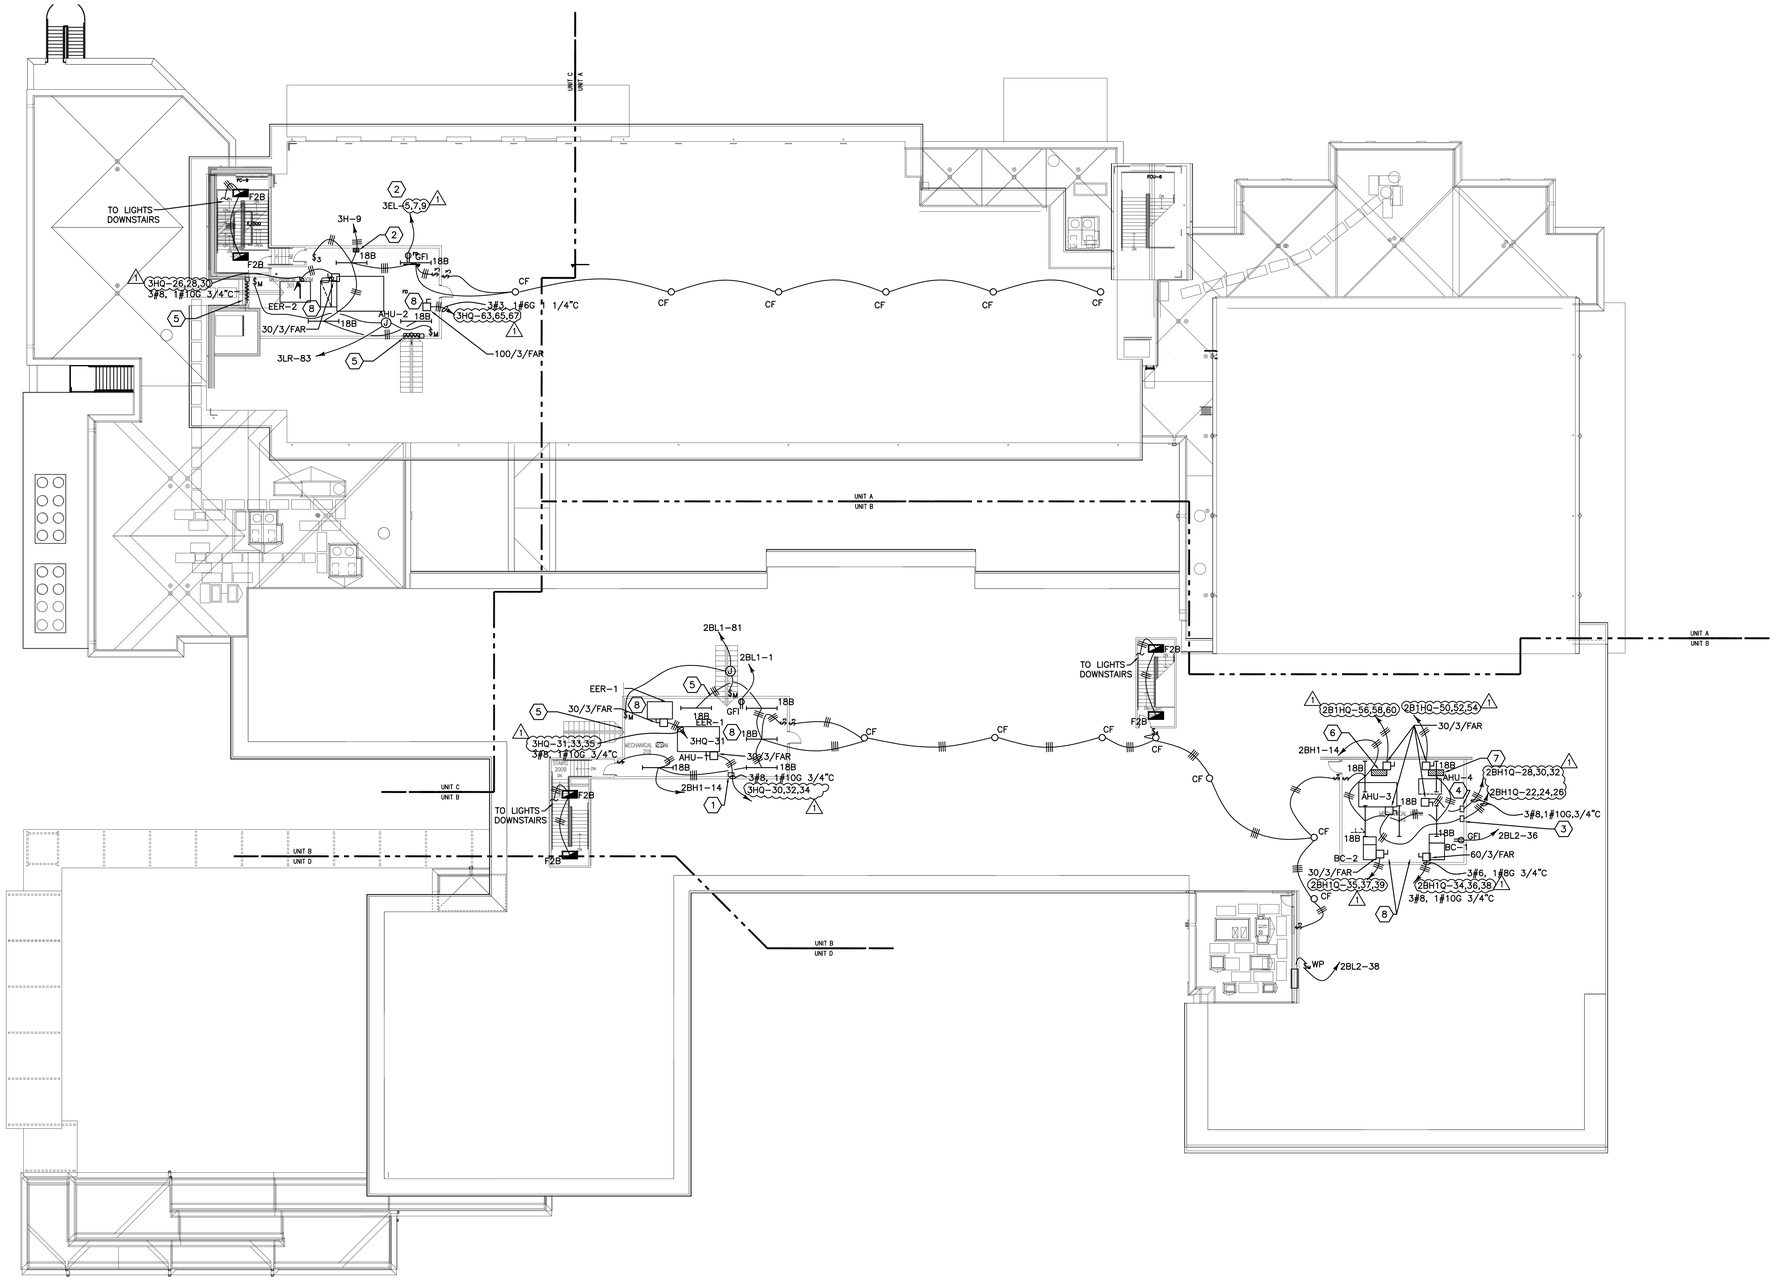

SPECIFIC NOTES:

1. VFD FOR AHU-1. PROVIDE NAMEPLATE STATING "VFD FOR AHU-1"
2. VFD FOR AHU-2. PROVIDE NAMEPLATE STATING "VFD FOR AHU-2"
3. VFD FOR AHU-3. PROVIDE NAMEPLATE STATING "VFD FOR AHU-3"
4. VFD FOR AHU-4. PROVIDE NAMEPLATE STATING "VFD FOR AHU-4"
5. MOTORIZED DAMPER
6. VAV 4-1
7. VAV 4-2
8. PROVIDE A VOICE/DATA OUTLET WITH (1) CAT.6 CABLE IN 3/4"C. ROUTE THE CABLE/CONDUIT TO COMMUNICATIONS ROOM 205 AND TERMINATE AS REQUIRED.

1 ATTIC LIGHTING, POWER, SPECIAL SYSTEMS, AND FIRE ALARM PLAN

SCALE: 1/16" = 1'-0"

PROJECT NORTH

TRUE NORTH

ASSOCIATED DESIGN GROUP, INC.
CONSULTING ENGINEERS

CORPORATE OFFICE
114 Toledo Drive
Lafayette, Louisiana 70506
(337) 234-5710

NEW ORLEANS BRANCH
1010 Common St.
Suite 2405
New Orleans, LA 70112
(504) 581-6333

Project # 09193

REVISIONS	BY
1 06-22-10	ADG

CONTRACTOR MUST VERIFY AND CHECK ALL JOB DIMENSIONS, DETAILS AND SPECIFICATIONS ON SITE AND REPORT ANY ERRORS, OMISSIONS AND DISCREPANCIES BEFORE PROCEEDING

NEW PHOENIX PRE-K THROUGH 12 SCHOOL

ATTIC LIGHTING AND POWER PLAN

SEAL

DRAWN:	ABF
CHECKED:	RAG
SCALE:	
DATE:	05-24-2010

E2.26

©