SPECIFIC NOTES

1. FEED FROM UTILITY DISTRIBUTION SYSTEM SHOWN ON ENLARGED KITCHEN PLAN SHEET E4.03.
2. AT EVERY 'VFD' AND HVAC CONTROLLER, PROVIDE A VOICE/DATA OUTLET WITH (2) RJ-45 JACKS AND (1) CAT 5E CABLE IN 3/4" CONDUIT TO THE NEAREST PATCH PANEL/TELECOMMUNICATIONS ROOM.

GENERAL NOTES:

1.) CONNECT VOLTAGE SENSING LOAD ON ALL BATTERY BACKED BALLAST TO NON-PROGRAMMABLE SIDE OF TANDEM BREAKER ON CIRCUIT SHOWN.

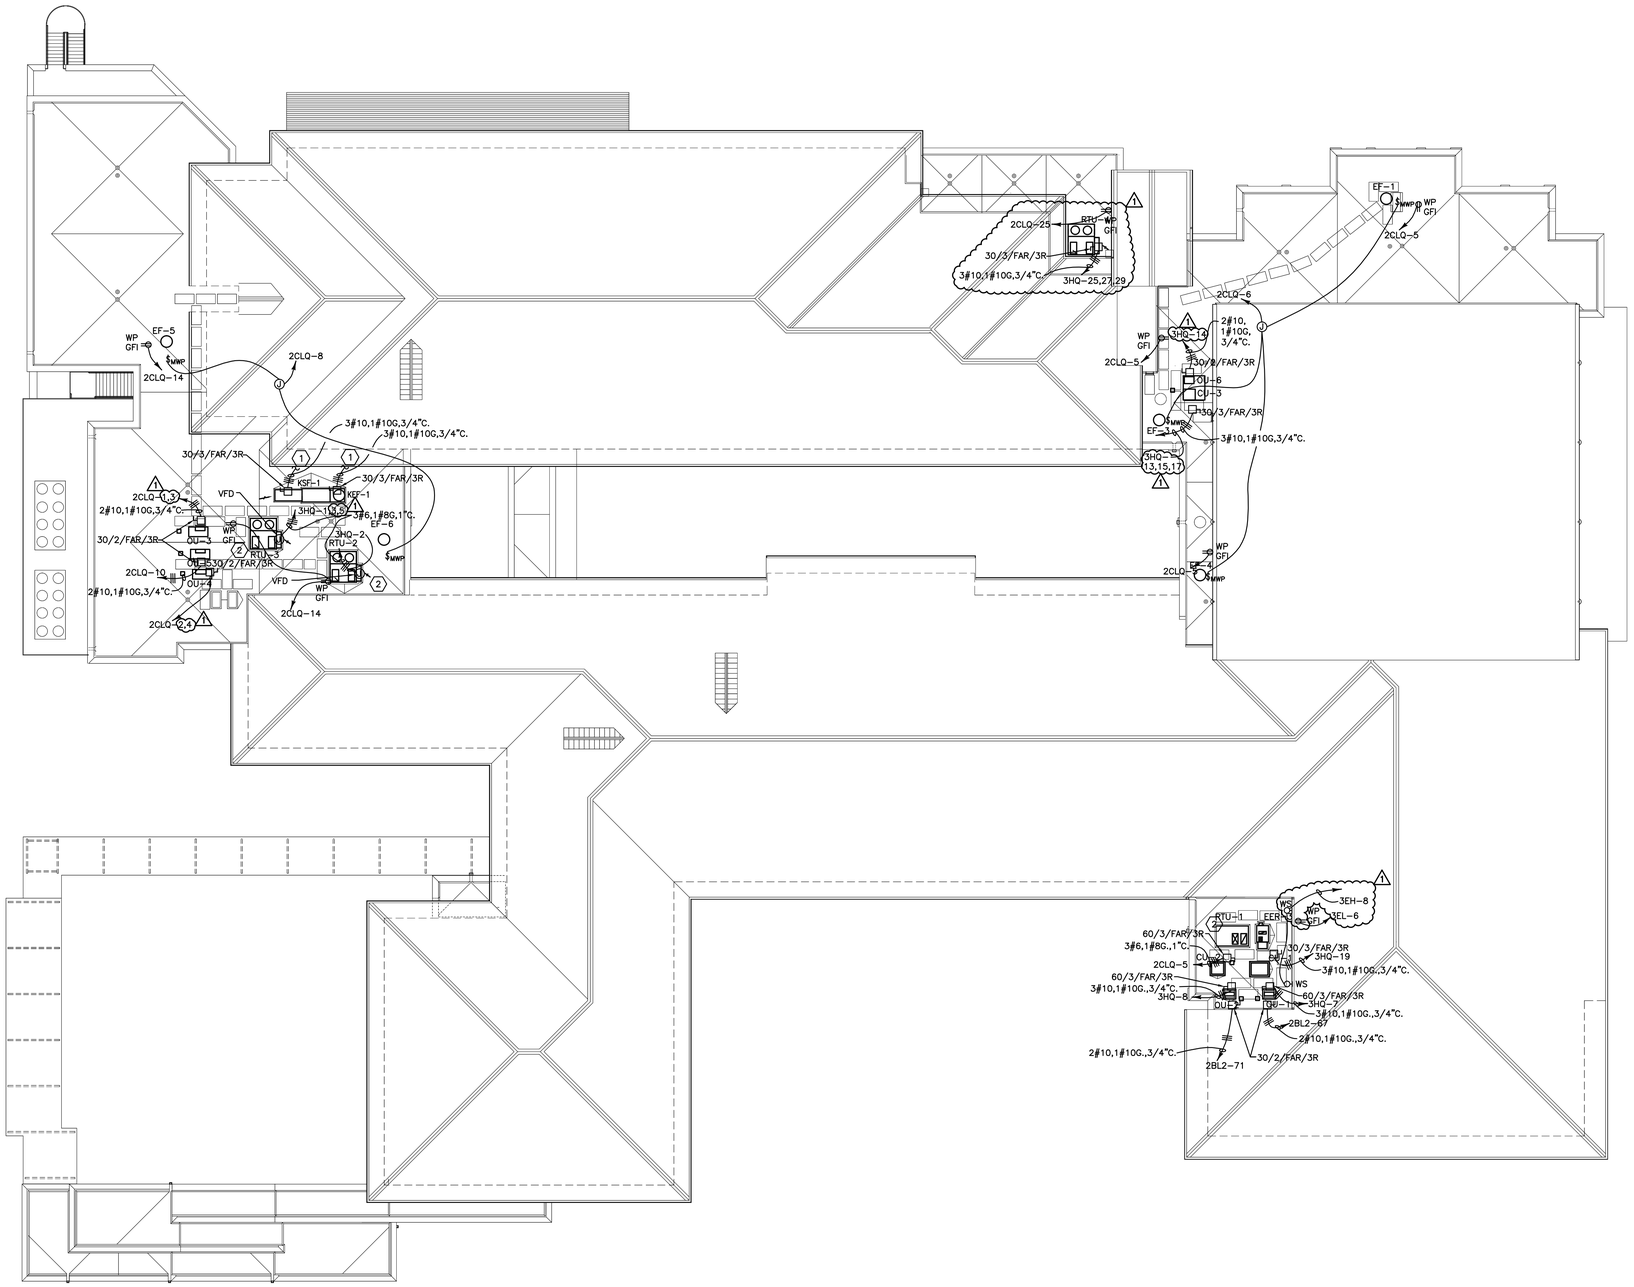

1 ROOF HVAC POWER, LIGHTING, & SPECIAL SYSTEMS PLAN

SCALE: 1/16" = 1'-0"

PROJECT NORTH

TRUE NORTH

ATTACHMENT NUMBER 55 TO ADDENDUM NUMBER ONE

REVISIONS	BY
1 06-22-10	ADG

CONTRACTOR MUST VERIFY AND CHECK ALL JOB DIMENSIONS, DETAILS AND SPECIFICATIONS ON SITE AND REPORT ANY ERRORS, OMISSIONS AND DISCREPANCIES BEFORE PROCEEDING

NEW PHOENIX PRE-K THROUGH 12 SCHOOL

ROOF HVAC POWER, LIGHTING, & SPECIAL SYSTEMS PLAN

SEAL

ASSOCIATED DESIGN GROUP, INC.
CONSULTING ENGINEERS

CORPORATE OFFICE
114 Toledo Drive
Lafayette, Louisiana 70506
(337) 234-5710

NEW ORLEANS BRANCH
1010 Common St.
Suite 2405
New Orleans, LA 70112
(504) 581-6333

Project # 09193

DRAWN:	ABF
CHECKED:	RAG
SCALE:	
DATE:	05-24-2010

E2.32

©