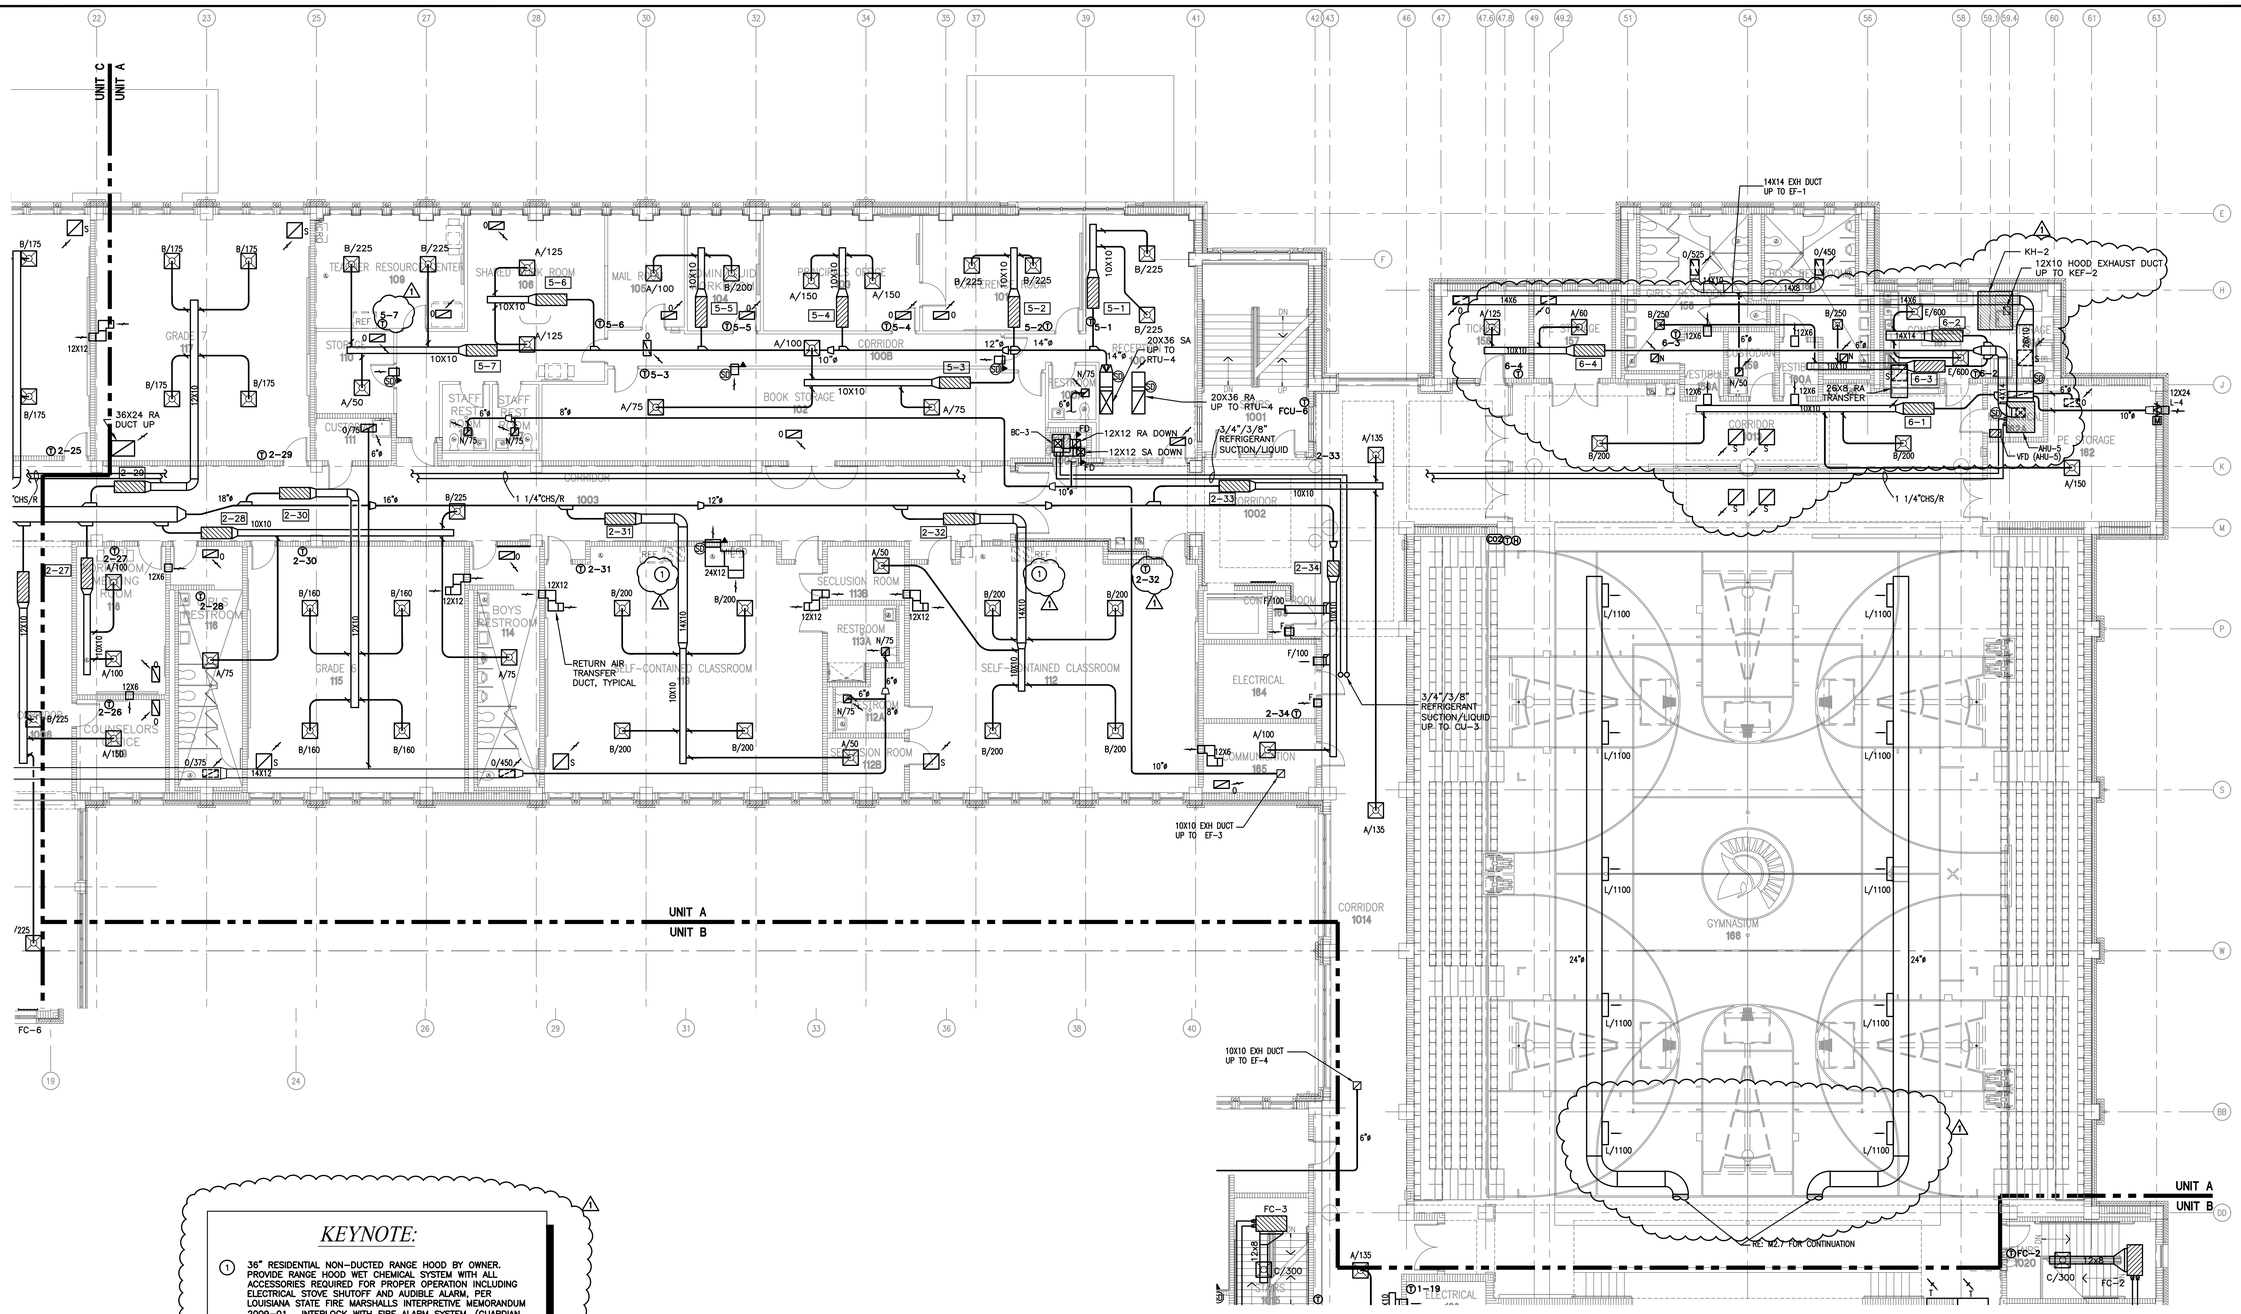

KEYNOTE:

1. 36" RESIDENTIAL NON-DUCTED RANGE HOOD BY OWNER. PROVIDE RANGE HOOD WET CHEMICAL SYSTEM WITH ALL ACCESSORIES REQUIRED FOR PROPER OPERATION INCLUDING ELECTRICAL STOVE SHUTOFF AND AUDIBLE ALARM, PER LOUISIANA STATE FIRE MARSHALLS INTERPRETIVE MEMORANDUM 2009-01. INTERLOCK WITH FIRE ALARM SYSTEM. (GUARDIAN MODEL 1384-A OR PEMALL SAFETY GOURMET MODEL PPA27-WE). PROVIDE TWO TYPE-K PORTABLE FIRE EXTINGUISHERS IN LOCATIONS SHOWN IN COOKING AREA, REFER TO ARCHITECTURAL PLANS.

1 UNIT A SECOND FLOOR MECHANICAL PLAN

SCALE: 1/8" = 1'-0"

PROJECT NORTH

TRUE NORTH

ATTACHMENT 37

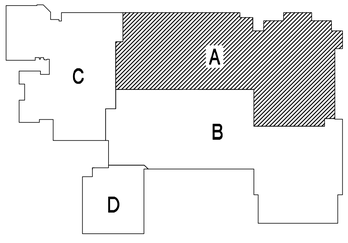

KEY PLAN

ASSOCIATED DESIGN GROUP, INC.
CONSULTING ENGINEERS

CORPORATE OFFICE
114 Toledo Drive
Lafayette, Louisiana 70506
(337) 234-5710

NEW ORLEANS BRANCH
1010 Common St.
Suite 2406
New Orleans, LA 70112
(504) 561-6333

Project # 09193

REVISIONS	BY
1 07-12-2010	JSL

CONTRACTOR MUST VERIFY AND CHECK ALL JOB DIMENSIONS, DETAILS AND SPECIFICATIONS ON SITE AND REPORT ANY ERRORS, OMISSIONS AND DISCREPANCIES BEFORE PROCEEDING

NEW PHOENIX PRE-K THROUGH 12 SCHOOL

UNIT A SECOND FLOOR MECHANICAL PLAN

SEAL

DRAWN:	ABF
CHECKED:	JSL
SCALE:	
DATE:	05-24-2010

M2.2

©